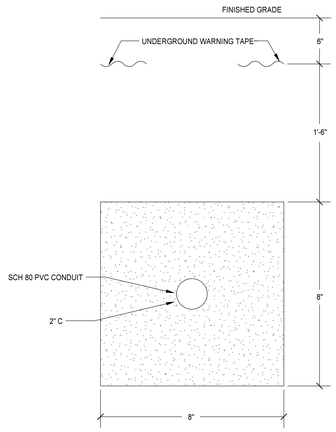

VDOT #10 SCREENINGS OR APPROVED ENGINEERED FILL THROUGHOUT
PROVIDE CONDUIT SPACERS EVERY 6'-0"

DUCTBANK DETAIL A-A - SAND BACKFILL

NO SCALE

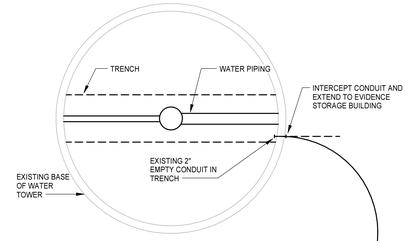

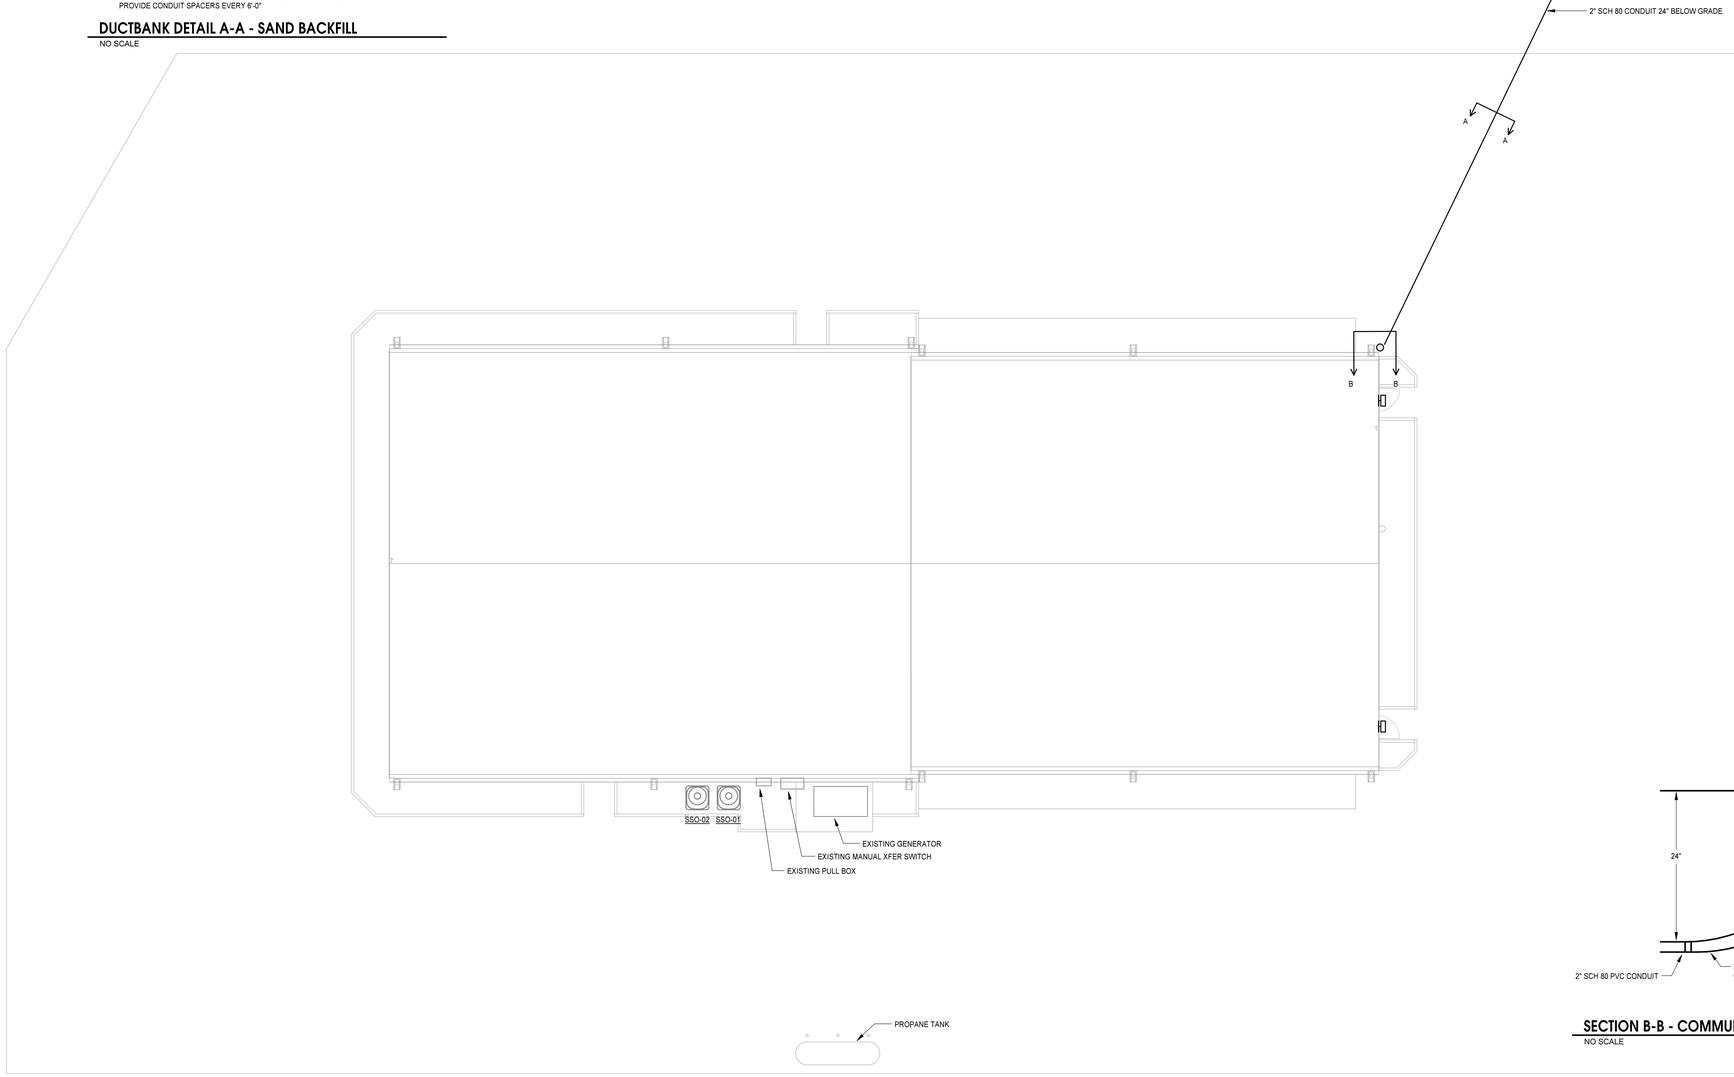

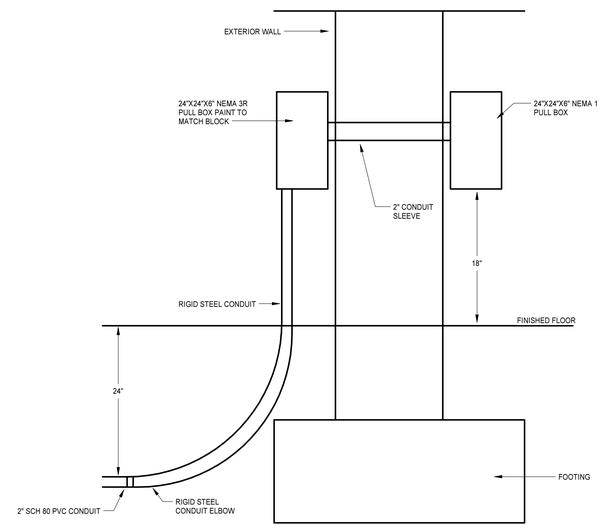

SECTION B-B - COMMUNICATION CONDUIT ENTRY DETAIL

NO SCALE

N

ELECTRICAL SITE PLAN

1/8" = 1'-0"

10/19/2015 10:58:14 AM

MOSELEYARCHITECTS
3200 NORFOLK STREET, RICHMOND, VA 23230
PHONE (804) 794-7555 FAX (804) 355-5690
MOSELEYARCHITECTS.COM

COMMONWEALTH OF VIRGINIA
HAROLD A. LANNA
Lic. No. 13231
10-15-2015
PROFESSIONAL ENGINEER

EVIDENCE STORAGE BUILDING

SMITHFIELD, VIRGINIA

PROJECT NO: 550322	DATE: OCTOBER 15, 2015
REVISIONS	
DATE	DESCRIPTION

ELECTRICAL SITE PLAN

E1.1