TERMINATION GENERAL NOTES

A. SEAL ALL NON-OBSTRUCTED HEAD-OF-WALL CONDITIONS IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS BASED ON CONDITION ENCOUNTERED (E.G.. CMU-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES); OR CFSF-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES). BRACE WALL AS INDICATED OR REQUIRED.

B. SEAL ALL NON-OBSTRUCTED HEAD-OF-WALL CONDITIONS IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS BASED ON CONDITION ENCOUNTERED (E.G.. CMU-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES); OR CFSF-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES) TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS. BRACE WALL AS INDICATED OR REQUIRED.

C. AT ALL WALLS PREVENTED FROM TERMINATING AT THE UNDERSIDE OF FLOOR/ROOF DECK BY OBSTRUCTIONS, COMPLY WITH THE FOLLOWING:

- AT FIRE-, SMOKE-, AND ACOUSTICALLY-RATED WALLS: ENCASE OBSTRUCTION(S) TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS.
- AT SECURITY WALLS: TERMINATE IN ACCORDANCE WITH SECURITY PARTITION REQUIREMENTS.
- AT OTHER WALLS: ENCASE OBSTRUCTION(S) ON ONE SIDE.
- SEAL ENCASEMENT TO WALL AND SEAL ENCASEMENT TO DECK IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS AND TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS.

LIFE SAFETY INFORMATION

THE CODE SUMMARY BELOW DOES NOT IDENTIFY ALL APPLICABLE CODE SECTIONS AND IS A SUMMARY OF SELECTED CODE SECTIONS ONLY. CODE SECTIONS NOT IDENTIFIED OR OTHERWISE INDICATED DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO COMPLY WITH APPLICABLE CODES, STANDARDS, AND REGULATIONS TO COMPLETE THE WORK.

1. APPLICABLE CODE: 2012 VIRGINIA REHABILITATION CODE (VRC)

2. EXISTING BUILDING CONSTRUCTION CLASSIFICATION: TYPE IIB

3. USE GROUP: MIXED USE, NON-SEPARTED, 'S-1' STORAGE AND 'B' BUSINESS. OVERALL USE GROUP 'S-1 STORAGE.

4. EXISTING BUILDING SQUARE FOOTAGE: 7,104 GROSS SQUARE FEET

5. REPURPOSED AREA WITHIN EXISTING BUILDING: 1,228 NET SQUARE FEET

6. EXISTING BUILDING IS NOT SPRINKLED AND SHALL REMAIN AS SUCH.

WALL/ PARTITION TYPE GENERAL NOTES

A. PLAN DIMENSIONS ARE TO FACE OF WALL OR PARTITION. WHERE APPLIED FINISHES OCCUR-SUCH AS CERAMIC TILE-DIMENSIONS ARE TO FACE OF APPLIED FINISH. FOR WAINSCOTS, FLOOR PLAN DIMENSIONS ARE TO FACE OF WAINSCOT MATERIAL. APPLIED FINISHES ARE NOT ALLOWED TO REDUCE CLEAR DIMENSIONS. "APPLIED FINISHES" IN THIS CASE DO NOT INCLUDE TRIM, BASE, AND ACOUSTIC WALL PANELS.

B. EXTEND WALL/PARTITION ASSEMBLY COMPONENTS FULL HEIGHT OF ASSEMBLY.

C. ALL INTERIOR PARTITIONS SHALL BE 'M1' UNLESS INDICATED OTHERWISE.

D. REFER TO STRUCTURAL DRAWINGS AND RELATED SPECIFICATIONS FOR SOLID MASONRY, GROUTING, AND REINFORCEMENT REQUIREMENTS INCLUDING BUT MAY NOT BE LIMITED TO:

- MASONRY WALLS/PARTITIONS
- LINTELS
- LINTEL BEARING CONDITIONS
- BOND BEAMS
- SHELF BEARING CONDITIONS
- STRUCTURAL REINFORCING REQUIREMENTS
- CHANGES IN WYTHE

E. THE TERMS "WALL" AND "PARTITION" MAY BE USED INTERCHANGEABLY THROUGHOUT THE CONTRACT DOCUMENTS.

F. EXTEND ALL FIRE-, SMOKE-, INCIDENTAL USE-, AND ACOUSTICAL-RATED WALLS/PARTITIONS TO UNDERSIDE OF FLOOR DECK, ROOF DECK, STRUCTURAL ELEMENT ENCASEMENT OR SOLID CAP ABOVE.

- SEAL AND TERMINATE IN ACCORDANCE WITH JOINT SYSTEM TESTED ASSEMBLIES FOR RESPECTIVE TYPE OF WALLS/PARTITIONS.

G. PARTITIONS THAT DO NOT EXTEND TO UNDERSIDE OF DECK OR CAP ABOVE:

- EXTEND 4 INCHES MINIMUM ABOVE HIGHEST ADJACENT FINISH CEILING UNLESS INDICATED OTHERWISE.

H. DO NOT CONNECT TIES, ANCHORS, OR REINFORCING TO SINGLE CANTILEVERED FIRE WALL OR BETWEEN DOUBLE FIRE WALLS.

I. SEAL AROUND ALL PENETRATIONS.

J. COMPLY WITH TERMINATION, WALL JOINT, AND MISCELLANEOUS DETAILS FOR THOSE CONDITIONS WHERE APPLICABLE. COMPLY WITH REFERENCED STANDARDS WHERE DETAILS ARE NOT IDENTIFIED IN THE DRAWINGS.

K. WALL/PARTITION TYPES DO NOT ADDRESS WALL FINISHES. REFER TO FINISH SCHEDULE.

L. FINISHED SPACES: PROVIDE PARTN 'P1' CHASES AROUND ALL EXPOSED VERTICAL COMPONENTS, INCLUDING, BUT MAY NOT BE LIMITED TO: DUCTWORK, PIPING, CONDUIT, AND RAIN LEADERS - UNLESS INDICATED OTHERWISE TO REMAIN EXPOSED.

- HOLD CHASES TIGHT TO COMPONENTS ALLOWING FOR ACCESS, INSULATION, AND TOLERANCES.
- EXTEND CHASES FROM FLOOR TO 4 INCHES MINIMUM ABOVE FINISH CEILING OR IF NO CEILING IS INDICATED, EXTEND CHASES TO UNDERSIDE OF FLOOR DECK, ROOF DECK, OR SOLID CAP ABOVE AND TERMINATE ACCORDINGLY.

M. PROVIDE BACKER BOARD/UNIT OF SAME THICKNESS INDICATED IN LIEU OF GYPSUM BOARD PANEL AT PORTIONS OF WALLS/PARTITIONS TO RECEIVE TILE.

TERMINATIONS

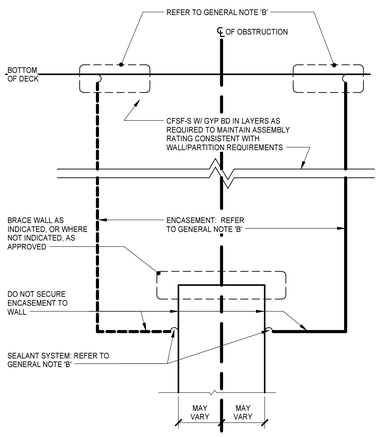

HEAD-OF-WALL TERMINATION @ OBSTRUCTION

OBSTRUCTION MAY VARY (BEAM, JOIST, GIRDER, CHANNEL, DUCTWORK, PIPING)



HEAD-OF-WALL TERMINATION @ NON-OBSTRUCTION

OCCUPANCY SCHEDULE

SPACE NUMBER	SPACE NAME	USE CLASSIFICATION	USED TO DETERMINE OCCUPANCY FACTOR ONLY	FLOOR AREA PER OCCUPANT	AREA			OCCUPANCY LOAD		
					SF	GROSS	NET	TABULAR	ACTUAL	DESIGN
101	CORRIDOR	B	BUSINESS AREAS	100 SF	352	•		4		4
102	CLOSET	B	BUSINESS AREAS	100 SF	7	•		1		1
103	AMMO/ RANGE STORAGE	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	80	•		1		1
104	SUPPLY STORAGE	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	86	•		1		1
105	IT/ DATA	B	BUSINESS AREAS	100 SF	84	•		1		1
106	WOMEN	B	BUSINESS AREAS	100 SF	51	•		1		1
107	MEN	B	BUSINESS AREAS	100 SF	51	•		1		1
108	MEN'S BREAK	B	BUSINESS AREAS	100 SF	222	•		3		3
109	MEN	B	BUSINESS AREAS	100 SF	58	•		1		1
110	SHOWER	B	BUSINESS AREAS	100 SF	7	•		1		1
111	WOMEN'S BREAK	B	BUSINESS AREAS	100 SF	233	•		3		3
112	WOMEN	B	BUSINESS AREAS	100 SF	58	•		1		1
113	SHOWER	B	BUSINESS AREAS	100 SF	7	•		1		1
114	UTILITY ROOM	B	BUSINESS AREAS	100 SF	72	•		1		1
115	FITNESS/ TRAINING ROOM	B	BUSINESS AREAS	100 SF	814	•		9	49	49
116	VEHICLE BAYS	S1	PARKING GARAGE	200 SF	3083	•		16		16
117	BAG & TAG	B	BUSINESS AREAS	100 SF	161	•		2		2
118	EVIDENCE OFFICER	B	BUSINESS AREAS	100 SF	161	•		2		2
119	LARGE EVIDENCE	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	69	•		1		1
120	PROPERTY & EVIDENCE	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	443	•		2		2
121	MECH/ ELEC	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	122	•		1		1
122	GUN CLOSET	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	55	•		1		1
123	DRUG CLOSET	S1	ACCESSORY STORAGE & MECHANICAL EQUIPMENT ROOM	300 SF	69	•		1		1
										96



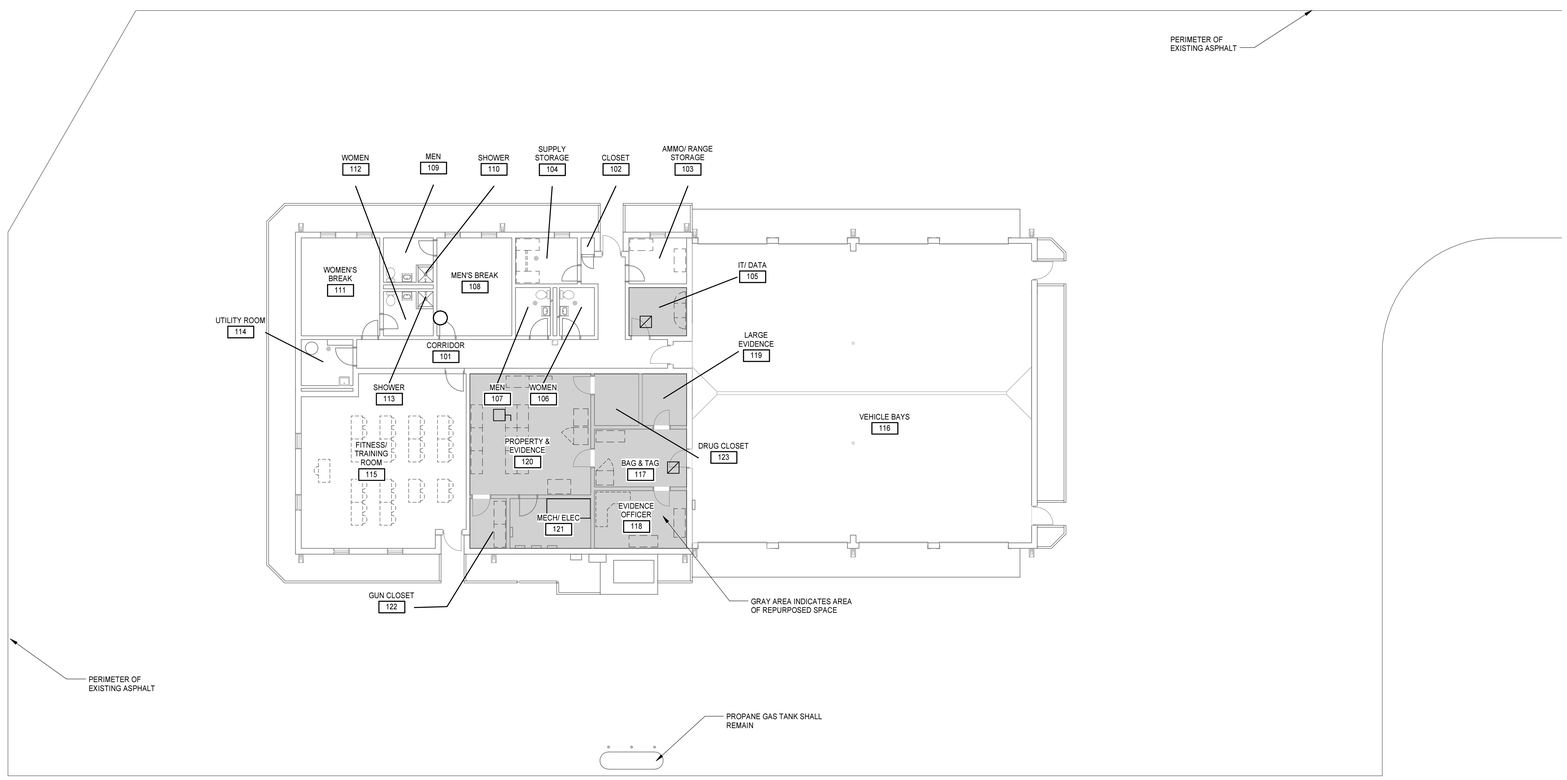

SITE PLAN/ FLOOR PLAN

3/32" = 1'-0"

WALL/ PARTITION TYPES

REPRESENTED BY Xnn

MARK	FIRE RATED ASSEMBLY	REMARKS	INFORMATION
M1	--	--	7 5/8" — 8" CMU
M2	--	--	11 5/8" — 12" CMU

MOSELEYARCHITECTS
3200 NORFOLK STREET, RICHMOND, VA 23230
PHONE (804) 794-7555 FAX (804) 355-5690
MOSELEYARCHITECTS.COM

COMMONWEALTH OF VIRGINIA
Lic. No. 009147
10/15/2015
ARCHITECT

EVIDENCE STORAGE BUILDING

SMITHFIELD, VIRGINIA

PROJECT NO: 550322	DATE: OCTOBER 15, 2015
REVISIONS	
DATE	DESCRIPTION

SITE PLAN, LIFE SAFETY, WALL TYPES

A0.2

10/16/2015 1:20:48 PM